





「 WF-2060 」 Package Checklist

The package includes the following items:

- One WF-2060 module
- One Quick Start
- One software utility CD
- One screw driver
- One RS-232 cable (CA-0910)
- One Antenna 2.4GHz 5 dBi (ANT-124-05)

Note:

1. If any of these items are missed or damaged, contact the local distributors for more information. Save the shipping materials and cartons in case you want to ship in the future.

2. This document supports the RevB version for the WF-2060 module. For the previous version, please refer the v1.x version quick start on the CD.

Appearance and pin assignments

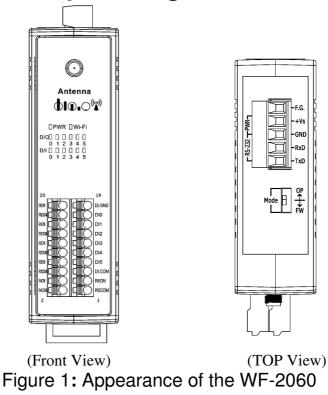




Table 1: I/O Connector - WF-2060

I/O Connector - WF-2060					
Terminal No.	Pin Assignment Terminal No.		Pin Assignment		
1	RL5 COM	2	RL4 COM		
3	RL5 NO	4	RL4 NO		
5	DI.COM	6	RL3 COM		
7	DI5	8	RL3 NO		
9	DI4	10	RL2 COM		
11	DI3	12	RL2 NO		
13	DI2	14	RL1 COM		
15	DI1	16	RL1 NO		
17	DI0	18	RL0 COM		
19	DI.GND	20	RL0 NO		

Table 2: Operating Mode Selector Switch

Operating Mode Selector Switch						
Mode	Jumper Position	Description				
FW	Mode FW	Firmware update mode				
OP	Mode FW	Firmware operation mode				

Table 3: Power/Signal Connector

Power/Signal connector				
Pin Assignment	Description			
F.G	Frame Ground			
+Vs	+10 ~ +30 VDC			
GND	Power / RS-232 GND			
RxD	RS-232 RxD			
TxD	RS-232 TxD			

Hardware Connection

Power and Serial port connection

The following figures describe the Power and the COM port to a serial device via serial network.

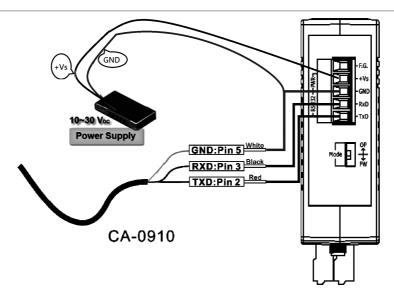


Figure 2: Power and Serial port wire connection

I/O connection

	1	1
Input	ON	OFF
Relay Contact (Dry)	Relay BIX Close GND	Relay DIx Open GND
Open Collector (Dry)	ON −↓ □⊖ DIx □⊖ GND	OFF - ↓ × □ ← DIx
Relay Contact (Wet)	+ □⊜ DI.COM Relay Close □⊖ DIx	+ □⊖ DI.COM □⊖ DIx Relay Open
NPN Output (Wet)		
Output	ON	OFF




Figure 3: DI / DO wire connection

• Installation

Before use, associated hardware configuration, the steps described as follows :

Step 1: Checking the WF-2000 series firmware operation mode

It needs to set the DIP switch to the "OP" position (operation mode), as resetting the power, WF-2000 series will be in the operation mode.

Step 2: Serial port connection

WF-2000 series supports RS-232 serial communication. The circuit configuration is as shown in Figure 2.

If you do not need parameter setting, this step can be omitted.

Step 3: Power connection

Connect the power supply to WF-2000 series' power terminator, as shown in Figure 2.

WF-2000 series connection setting

WF-2000 Series Connection Configuration

Vetwork					Wi-Fi			General	
Net ID	1			•	Wi-Fi Modes	Limited AP	•	F/W Version	B.1
DHCP Ena	able				SSID Auto	Search Searc	ch	Date Created	2016/7/21
IP Address	192	168	255	1	SSID	WF-20		🔽 Auto Disconne	ect
Subnet Mask	255	255	0	0	Encryption	NONE	-	Comm. Net ID	1
Gateway	192	168	255	254	Wireless Key			RS-232 -	COM3 -
MAC Address	00-1	D-C9-:	1A-C7·	-BF	Wireless CH	2		Write	Read
DHCP Ser	ver Ena	ible (Lim	ited AP	Mode)					
Start IP Addr.	102	160	255	100					

Figure 4: Connection Configuration

- 01 Net ID : The Unit Identifier in Modbus TCP/IP application data unit. This case is set as "1".
- 02 · IP Address: WF-2000 series' IP address. Here set to "192.168.255.1".
- 03 Subnet Mask : Net Mask settings. Here set to "255.255.0.0".
- 04 · Gateway : Gateway settings. Here set to "192.168.255.254".
- 05 Wi-Fi Mode : Wireless network connection mode settings. Here set to "Limited AP" mode. (If select the "Limited AP" mode, the "DHCP Server" function is enabled)
- 06 SSID : Service set identifier. Here set to "WF-2060".
- 07 Encryption : Encryption mode settings. Here set "NONE" (without encryption).
- 08 · Wireless Key : Wireless encryption Key. Here does not have the setting.
- 09 · Wireless CH : Wi-Fi connection channel settings. Here set to "2".
- 10 Vpload parameters : After completing the settings above, select the "RS-232" interface, communication "Net ID" and "COM Num". Press "Write" button to upload the parameters.

PC Wireless Network Configuration and Connection

- 01 \ TCP/IP Setting :
 - a. Entry the **IP address** as "192.168.255.x", where "x" is a number between 1 and 254 **except 1**, **Subnet mask** as "255.255.255.0". Finally, press "OK" button.
- 02 · Wireless network connection :
 - a. View available wireless networks and you can see the "WF-2060" wireless network in the list.
 - b. Select the "WF-2060" and press the "Connect" button.
 - c. After waiting for a while, there will appear connection success screen.

Internet Protocol (TCP/IP) Pro	operties 🛛 🕐 🚺					
General						
	utomatically if your network supports I to ask your network administrator for					
O <u>O</u> btain an IP address automa	ically					
• Use the following IP address:						
IP address:	192 . 168 . 255 . 10					
Sybnet mask: 255 . 255 . 0						
Default gateway:						




Figure 5: IP configuration interface

Access I/O data

01 · Connection with Modbus TCP utility

a. Open Modbus TCP utility and key in the IP address as "192.168.255.1", Port as "502". Finally, press the "Connect" button.

B. MBTCP Ver. 1.1.4	an an in	×
ModbusTCP IP: 192.168.255.1 Port: 502 Connect Disconnect	Protocol Description FC1 Read multiple coils status (0xxxx) for DD [Prefixed 6 bytes of Modbus/TCP protocol] Byte 0: Transaction identifier - copied by server - usually 0 Byte 1: Transaction identifier - copied by server - usually 0 Byte 2: Protocol identifier=0	•
	Byte 3: Protocol identifier=0	

Figure7: Modbus TCP utility Connection interface

b. Use the function code "0x0F", and set the reference number as "0x00" to do the DO output control.



Figure 8: DO output control interface

c. Use the function code "0x01", and set the reference number as "0x00" to get the DO output monitor data.

[Byte0] [Byte1] [Byte2] [Byte3] [Byte4] [Byte5] [120006 110006		Send Command		
[Byte0] [Byte1] [Byte2] [Byte3] [Byte4] [Byte5]	[Byte0] [Byte1] [Byte2] [Byte3]			
01 02 00 00 00 06> 01 01 00 00 00 06	01 02 00 00 00 04> 01 01 01 3F			

Figure 9: DO output monitor interface

d. Use the function code "0x02", and set the reference number as "0x00" to get the DI input monitor data.



Figure 10: DI input monitor interface

e. Use the function code "0x04", and set the reference number as "0x32" to get the Counter monitor data.

[Byte0] [Byte1] [Byte2] [Byte3] [Byte4]	3yte5]
120006 1 40320C	Send Command
[Byte0] [Byte1] [Byte2] [Byte3] [Byte4]	Byte5] [Byte0] [Byte1] [Byte2] [Byte3]
01 02 00 00 00 06> 01 04 00 32 00 0C	01 02 00 00 00 1B> 01 04 18 00 2D 00 00 02 E 00 00 00
	2E 00 00 00 2D 00 00 2E 00 00 00
	32 00 00

Figure 11: Counter monitor interface

Table 4: (0xxxx) DO address

Begin Address	Points	Descriptions	Range	Access Type
00001	1~6	Digital Output	0=OFF, 1=ON	R/W
00011	1~6	Clear High Speed Counter	1=Clear	W
00021	1~6	Clear Low Speed Counter	1=Clear	W

Table 5: (1xxxx) DI address

Begin Address	Points	Descriptions	Range	Access Type
10001	1~6	Digital Input	0=OFF, 1=ON	R

Table 6: (3xxxx) AI address

Begin Address	Points	Descriptions	Range	Access Type
	1~12			
30051	(2 points/ Each Channel)	High Speed Counter	0~4294967295	R
	1~12			
30071	(2 points/ Each Channel)	Low Speed Counter	0~4294967295	R

Troubleshooting		
Item	Problem Description	Solution
1	Power Failure (PWR LED Off)	1. Please return to the ICP DAS for inspection and repair
2	WLAN connection can not be established	 Make sure that the service set identifier device (SSID) settings are the same. Make sure Wi-Fi transmission Channel settings are the same. Make sure encryption is set, encryption keys are the same way Make sure antenna is connected Please confirm whether there are barriers on the scene. That could result in poor signal quality.
3	TCP connection can not be established	 Make sure WLAN connection is established successfully Make sure the network configuration is good (TCP / IP Port, Local IP, Net Mask)
4	How to restore factory default Step1 Step2	 Power on the WF-2000 series I/O module Change the Dip-Switch position of the WF-2000 series and to complete the following steps in 5 seconds. Step1. From "OP" to "FW" position. Step2. From "FW" to "OP" position. Step3. From "OP" to "FW" position. Step4. From "FW" to "OP" position. When the correct implementation of the above steps, the Signal Strength LEDs and PWR/Wi-Fi LEDS of the WF-2000 series should be turn on, and that should be turn off after 500 ms later. Reset the power the WF-2000 series would back to factory defaults.

Troubleshooting

Technical Support

If you have problems about using the WF-2000 series I/O module, please contact ICP DAS Product Support.

Email: service@icpdas.com